


1- HORIZONTAL HEADWALL (EQ-24) & BED DOCKING LOCATION (EQ-23) IN NURSING LABS

SCALE: 1/2" = 1'-0"

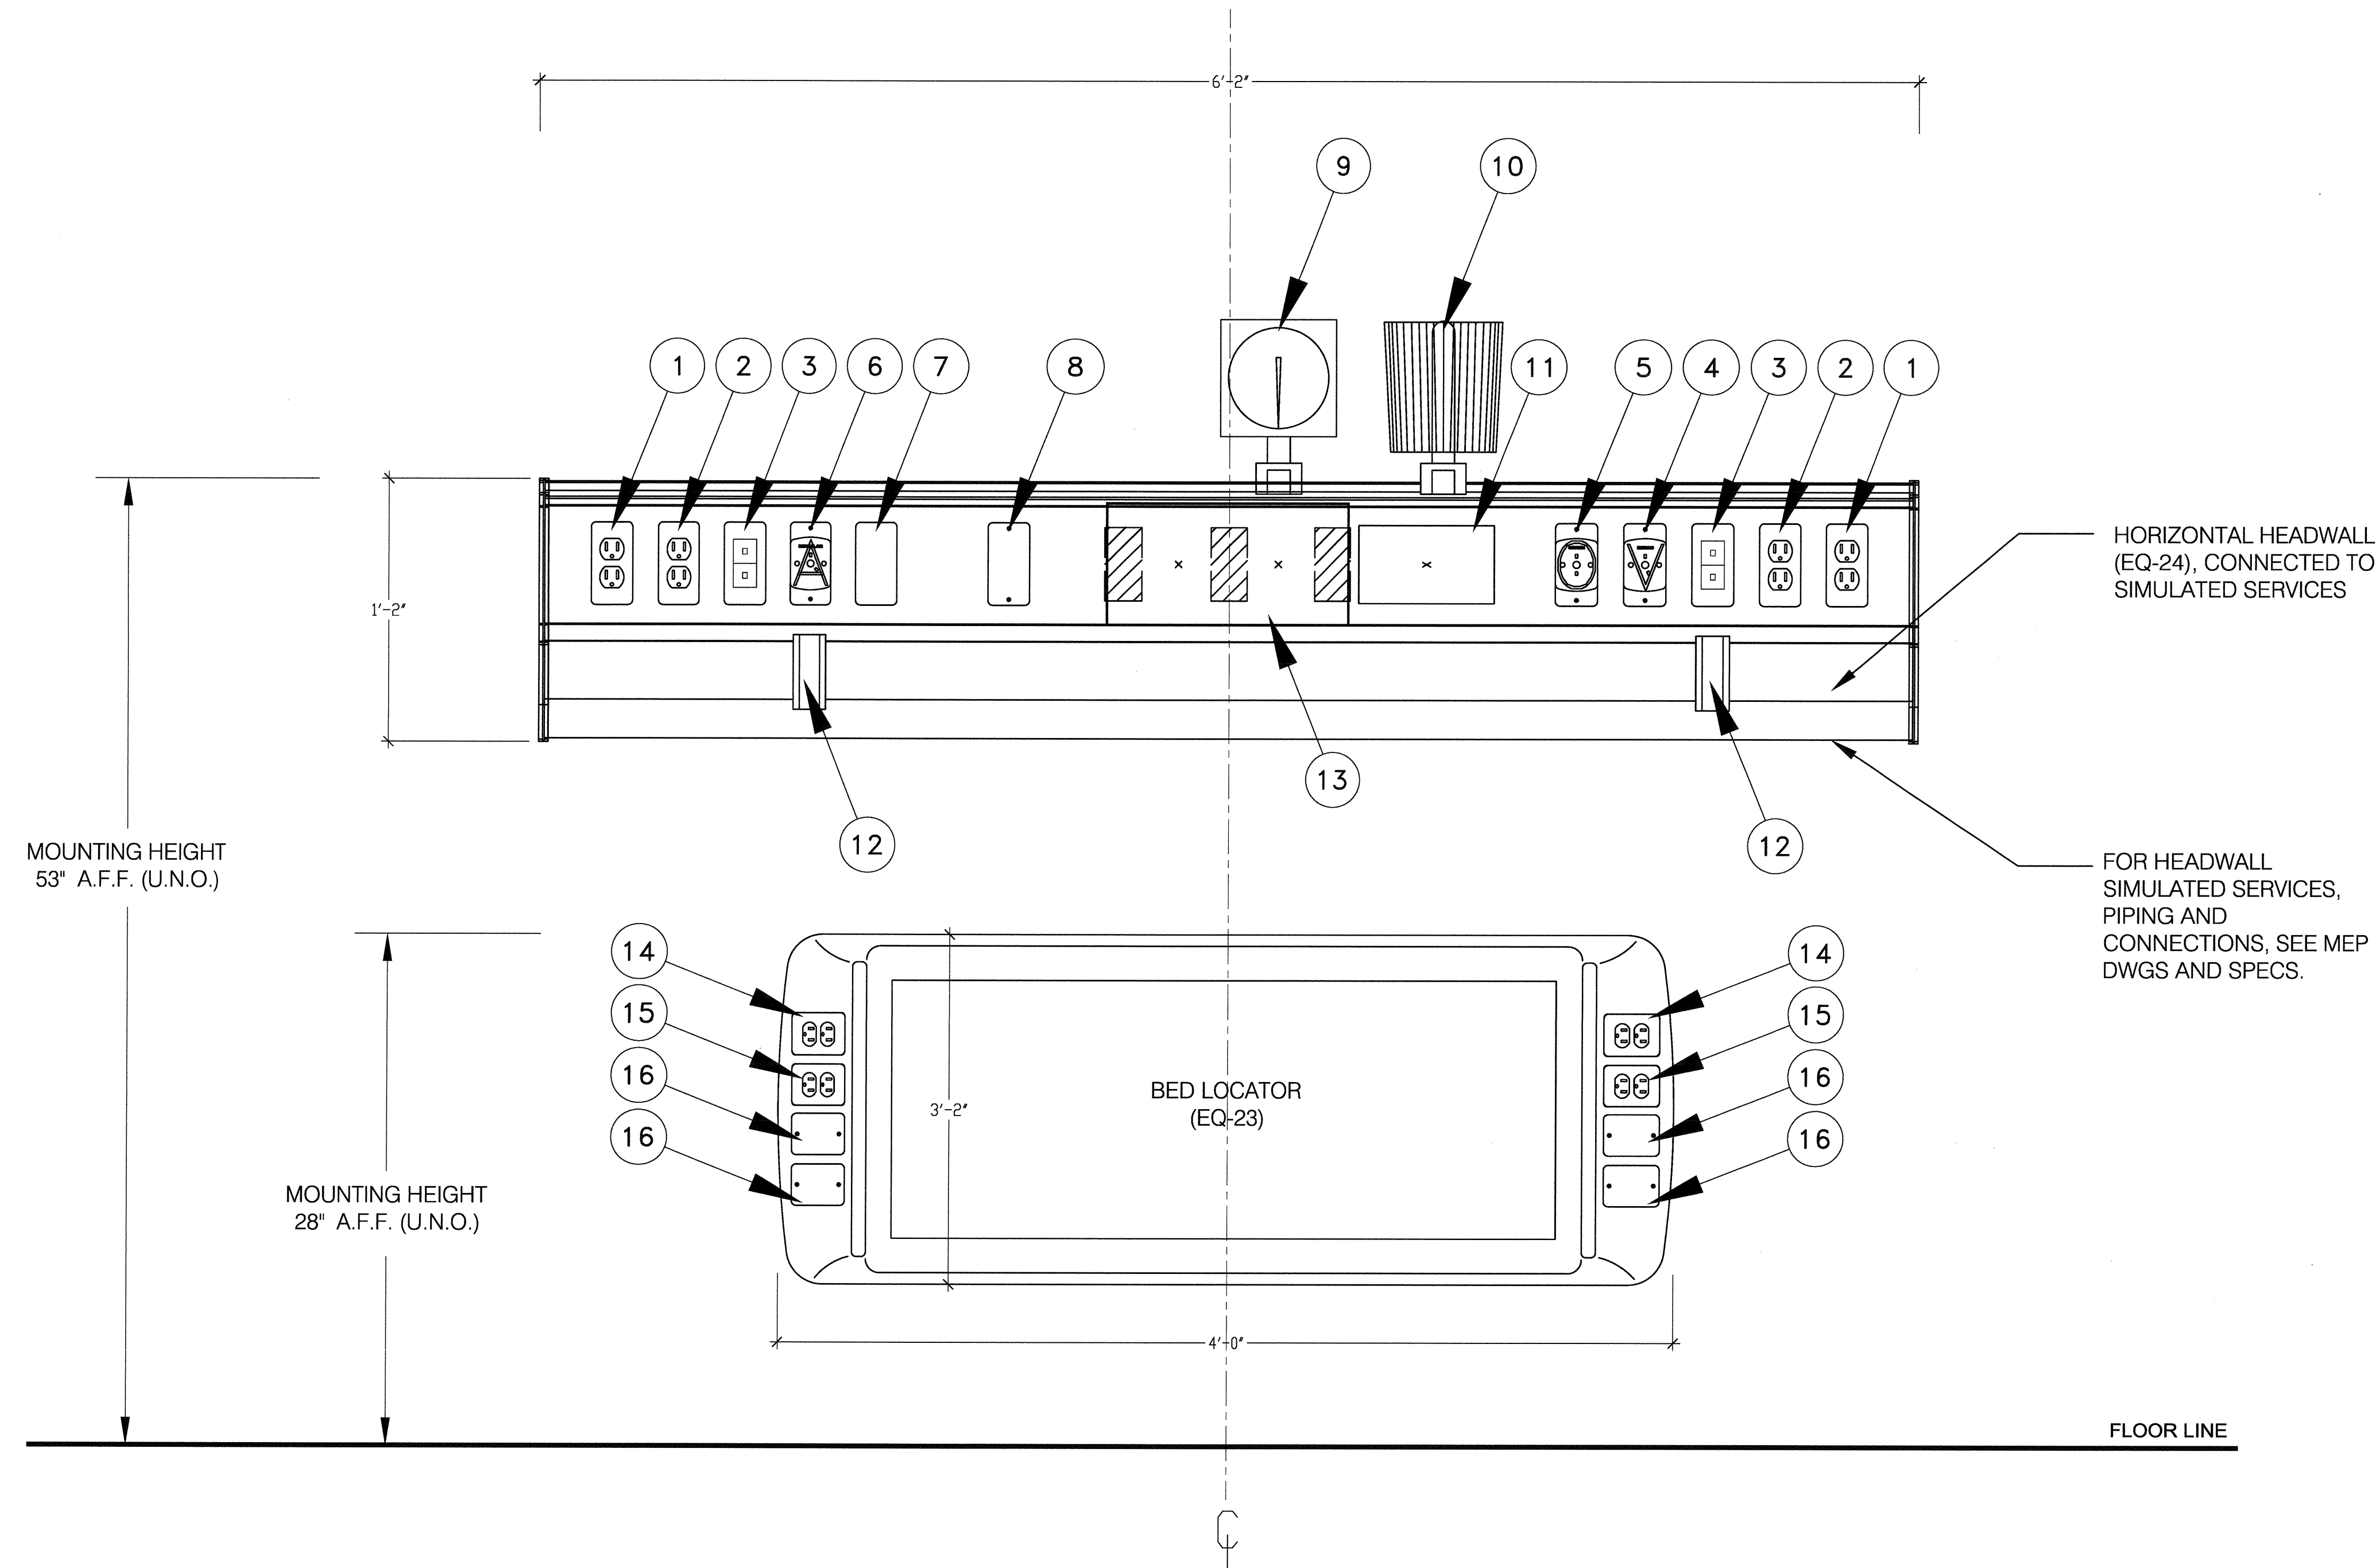

SERVICE SCHEDULE

ITEM #	DESCRIPTION
1	110V DUPLEX ELECTRICAL RECEPTACLES (IVORY COLOR)
2	110V DUPLEX ELECTRICAL RECEPTACLES (RED COLOR) FOR SIMULATION OF EMERGENCY POWER
3	DOUBLE DATA OUTLETS (PORTS)
4	MEDICAL VACUUM (SIMULATED SERVICE)
5	MEDICAL OXYGEN (SIMULATED SERVICE)
6	MEDICAL AIR (SIMULATED SERVICE)
7	BLANK (1 GANG WITH FACEPLATE)
8	BLANK (1 GANG WITH FACEPLATE)
9	ANEROID SPHYGMO
10	UTILITY BASKET
11	PROVISION FOR NURSECALL EQ-36 (EDWARDS 6538 SYSTEM TO BE PROVIDED BY OWNER)
12	BOTTLE SLIDE UTILITY
13	HEADWALL JUNCTION BOX BEYOND, SEE ELECTRICAL DRAWINGS.
14	110V DUPLEX ELECTRICAL RECEPTACLES (IVORY COLOR) FOR BED LOCATORS.
15	110V DUPLEX ELECTRICAL RECEPTACLES (RED COLOR) FOR BED LOCATORS.
16	BLANK (1 GANG WITH FACEPLATE)

NOTES

BED LOCATORS AND HEADWALLS SHOULD BE CENTERED WITH PATIENT BEDS AS SHOWN ON LAB PLANS AND ELEVATIONS.

HEADWALLS (EQ-24) SHALL BE CAPABLE TO ACCOMMODATE THE FOLLOWING ACCESSORIES: UNIVERSAL HOLDERS FOR OTOSCOPE, OPHTALMOSCOPE AND THERMOMETER, BRACKET AND BASKET FOR ANEROID MANOMETER, I.V. TREE, GLOVE BOX HOLDER, SHARPS CONTAINER ASSEMBLY, MANUAL RESUSCITATION HOLDER, TILT SWIVEL MONITOR ARM. (SEE SPEC. 11680 FOR DETAILS). SERVICE OUTLETS INDICATED SHALL BE PROVIDED AND CONNECTED TO SERVICE CONNECTIONS AS INDICATED ON MEP DRAWINGS & SPECIFICATIONS.

HEADWALLS (EQ-25) SHALL BE IDENTICAL TO (EQ-24) WITH ALL SERVICE FEATURES INDICATED ON DETAIL 1/44G, EXCEPT THAT OUTLETS WILL BE DUMMY SERVICE OUTLETS NOT TO BE CONNECTED TO PIPING OR WIRING. MOUNT HEADWALLS (EQ-25) AT LOCATIONS INDICATED ON PLANS AND ELEVATIONS WITHOUT SERVICE CONNECTIONS

2- SHELF TYPE R01 IN PHYSICS / CHEMISTRY LAB

NOT TO SCALE

